

C.I.P.**375 H&H Mag.**

TAB.

III


Date

84-06-14

Pays d'origine: GB

Révision

02-05-15

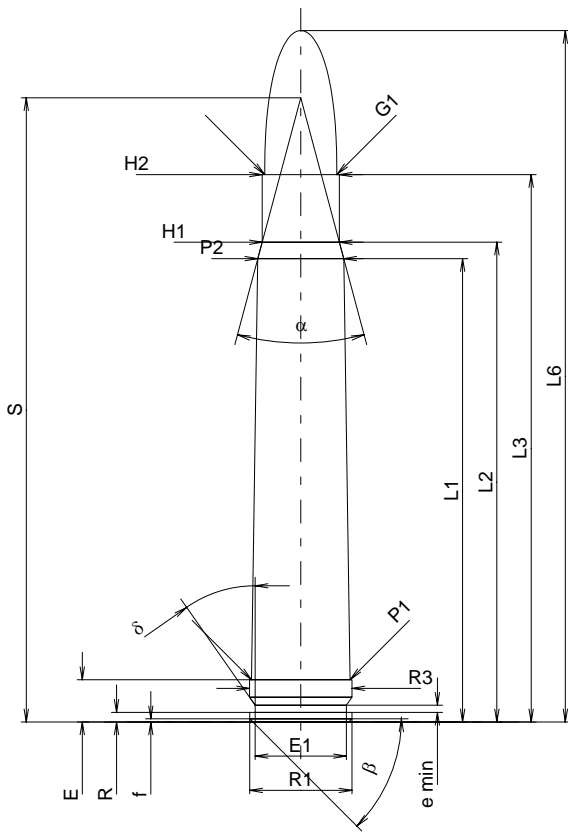**CARTOUCHE MAXI****Longueurs**

L1 *	=	61.27
L2 *	=	63.44
L3 ¹⁾	=	72.39
L4	=	
L5	=	
L6	=	91.44

Culot

R	=	1.27
R1	=	13.51
R3	=	13.56
E ¹⁾	=	5.59
E1	=	12.07
e min	=	0.94
delta	=	35°
f	=	0.41
beta	=	45°

Chambre à poudre

P1	=	13.03
P2 *	=	11.37

Cône de raccordement

alpha	=	29°55'43"
S	=	82.54
r1 min	=	
r2	=	

Collet

H1 *	=	10.21
H2 ¹⁾	=	10.21

Projectile

G1 ¹⁾	=	9.55
G2	=	
F	=	
L3+G ¹⁾	=	81.30

Pressions (Énergies)**Méthode transducteur**

Pmax	=	4300 bar
PK	=	4945 bar
PE	=	5375 bar
M	=	25.00
EE	=	6090 Joule

Autres indications

Fe ¹⁾	=	0.10
delta L	=	

CHAMBRE MINI**Longueurs**

L1 *	=	61.38
L2 *	=	63.44
L3 ¹⁾	=	72.90

Cuvette

R	=	
R1	=	13.59
R2	=	
R3	=	13.59
r	=	

Chambre à poudre

E ¹⁾	=	5.59
P1 ¹⁾	=	13.06
P2 *	=	11.39

Cône de raccordement

alpha	=	29°53'52"
S	=	82.71
r1 max	=	
r2	=	

Collet

H1 *	=	10.29
H2 ¹⁾	=	10.26

Prise de rayures


G1 ¹⁾ *	=	9.91
G ¹⁾ *	=	8.91
alpha1	=	90°
h *	=	0.18
s	=	
i ¹⁾	=	2°00'02"
w	=	

Canon

F ¹⁾ *	=	9.30
Z ¹⁾	=	9.55

Rayures

b	=	2.92
N	=	6
u	=	305.00
Q	=	70.16 mm ²

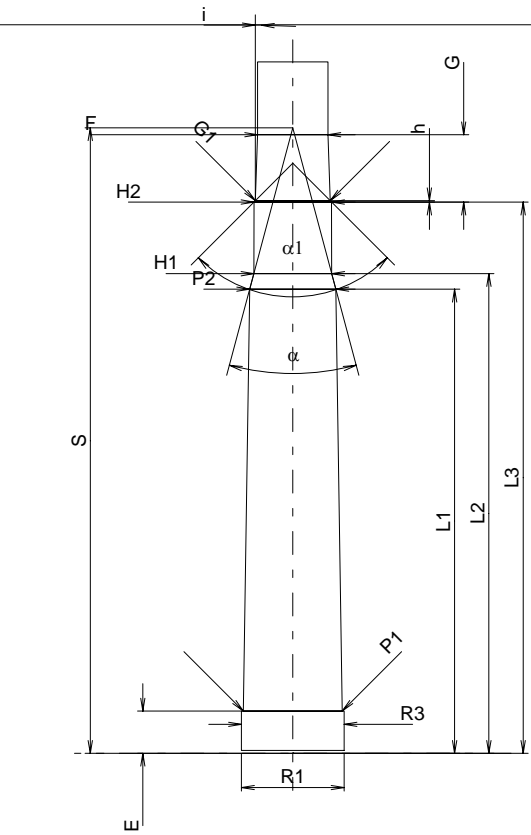

Échelle 1:1

Dimensions en << mm >>
Dimensions et tolérances pour les canons
d'épreuve: Voyez Annexe CR 1.

Notes: 1) A' contrôler pour la sécurité
* Dimensions de base